


## Temporary Service Standards

### GENERAL INFORMATION

**METER BASE MUST BE INSTALLED WITHIN 10' OF KV REMC FACILITIES**

KV REMC DOES NOT FURNISH METER BASES FOR TEMPORARY SERVICES  
IT IS THE EXPECTATION THAT THE PERMANENT SERVICE IS INSTALLED WITHIN 1 YEAR  
OF THE TEMPORARY SERVICE.

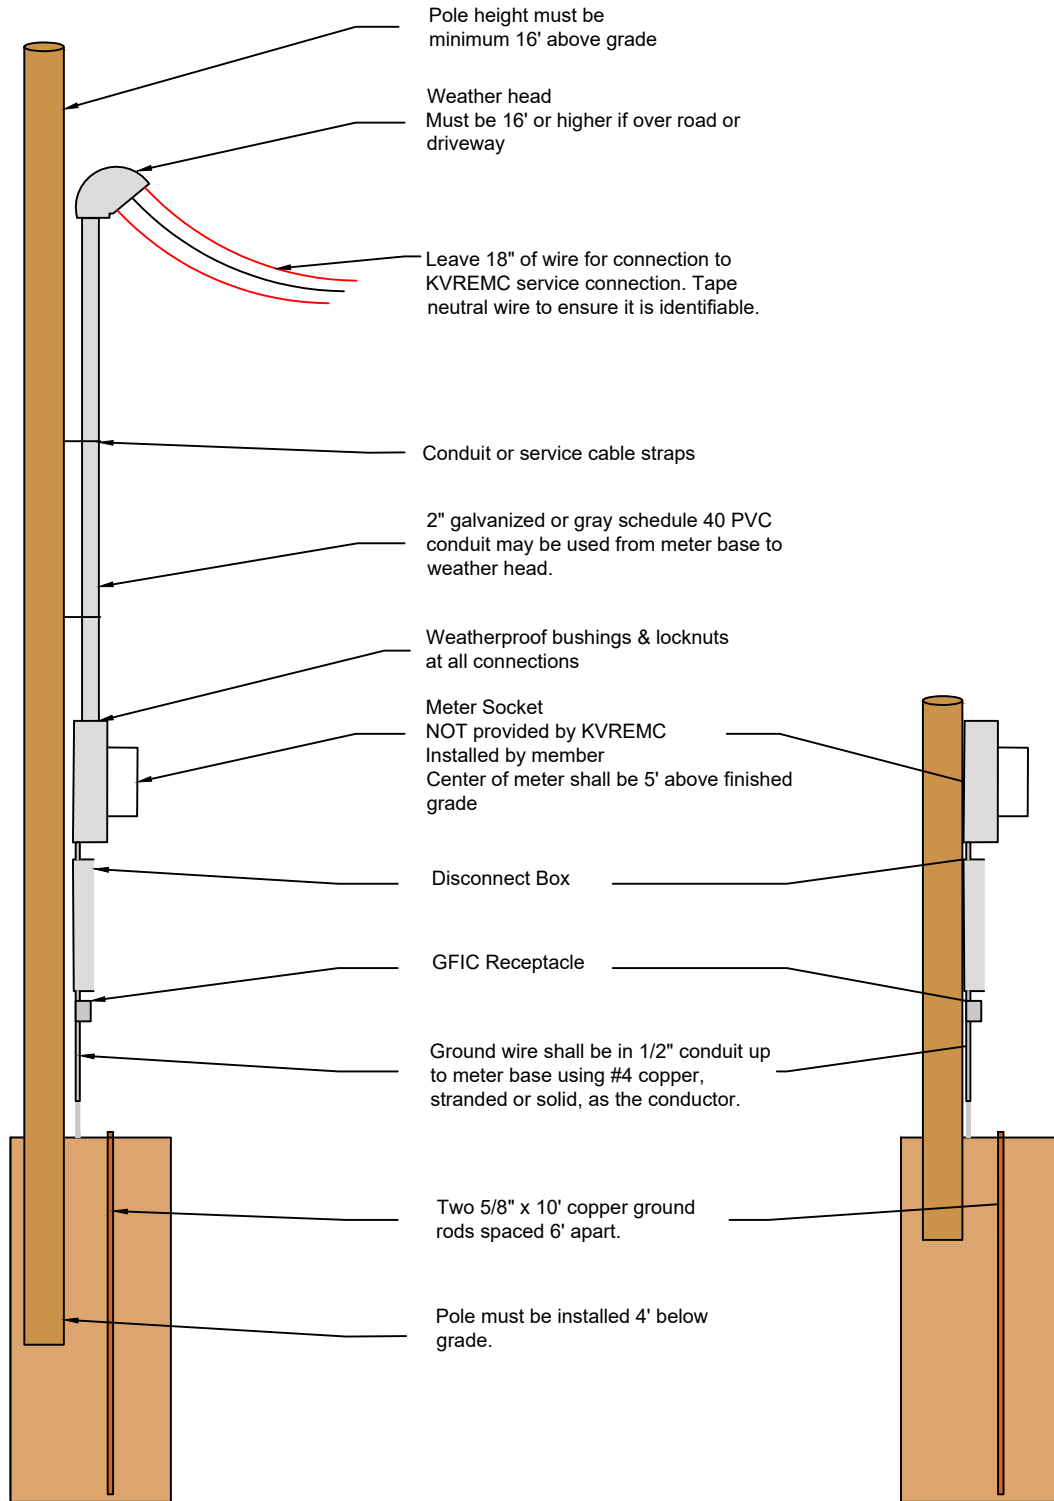


**Overhead Temp Service**

**Underground Temp Service**

# SERVICE ENTRANCE GUIDE

SERVICE ENTRANCE SIZE	CONDUIT INTO METER BASE	1PH, 3W 120/240V	GROUNDING (COPPER ONLY, STRANDED OR SOLID)
100A	1.5" OR 2"	#4 CU	#4 CU
	2"	#2 AL	#4 CU
200A	2"	2/0 CU	#2 CU
	2.5"	4/0 AL	#2 CU
320A (2 - 200A DISCONNECTS)	3"	2/0 CU PER DISCONNECT	#2 CU
	3"	4/0 AL PER DISCONNECT	#2 CU
320A (1 - 400A DISCONNECT)	3"	350MCM CU	#2 CU
	3"	500MCM AL	#2 CU

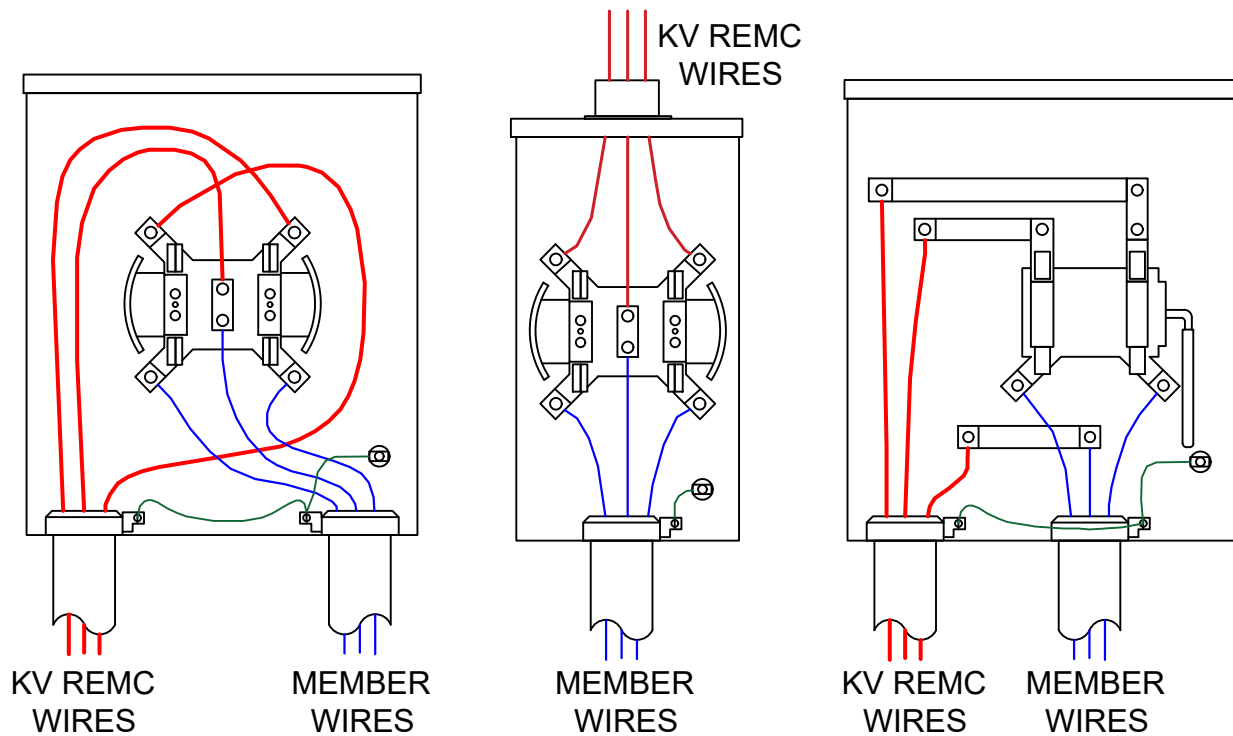

**200A 120/240V, 1PH, 3W**

**OVERHEAD  
100/200A 120/240V  
1PH, 3W**

**320/400A 120/240V  
1PH, 3W**